


Column Cap



LRC In-Stock Hangers

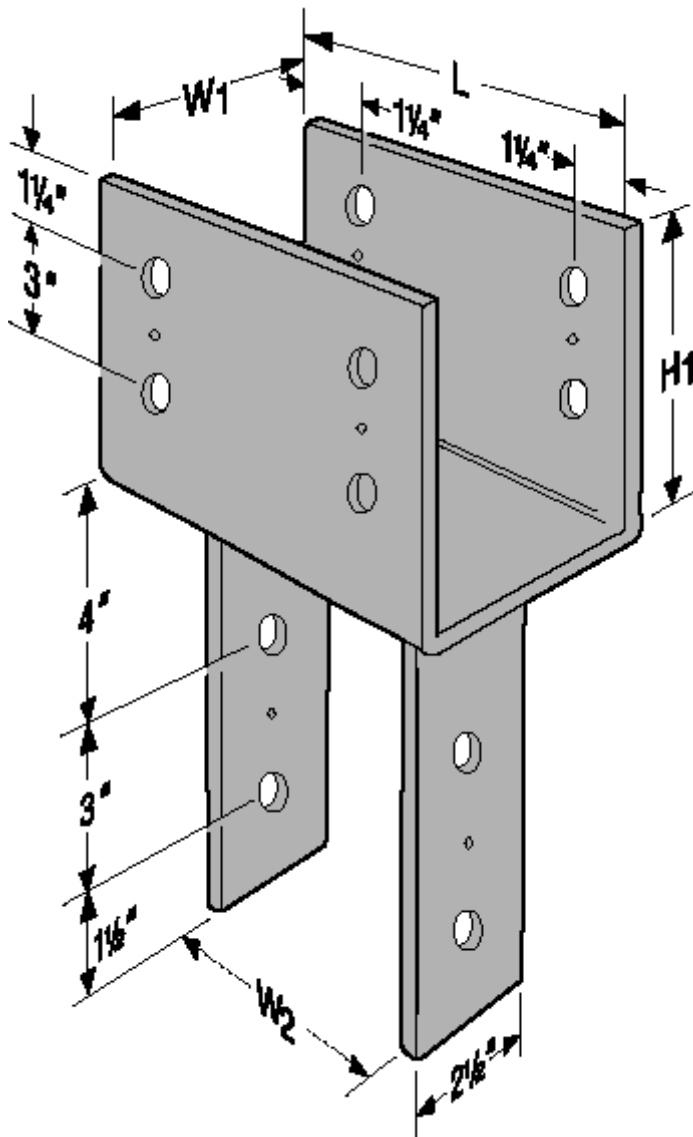

INSTALLATION:

Use all specified fasteners
 Bolt holes shall be a minimum of 1/32" to a maximum of 1/16" larger than the bolt diameter (per 1997 NDS, section 8.1.2.1.).

1. Post sides are assumed to lie in the same vertical plane as the beam sides.
2. Loads may not be increased for short-term loading.
3. Downloads are determined using F_c equal to: 560 psi for glulam sizes and CC86, CC88 and CC106; 750 psi for 71.. size; 625 psi for all others; reduce where end bearing value of post, L/R of post, or other criteria are limiting.
4. Uplift loads have been increased 33% and 60% for earthquake or wind loading; reduce for other loading conditions in accordance with the code. Uplift loads are limited by the beam shear capacity per 1997 NDS Section 3.4.5 except CC76, CC78, and CC96 through CC106.
5. ECC downloads assume a post of $W_1 \times W_2$.
6. Spliced conditions must be detailed by the specifier to transfer tension loads between spliced members by means other than the column cap.
7. Uplift loads do not apply to splice conditions.

The industry standard column cap. Precision factory gang-punched holes speed installation on this product line.

| Model No. | Dimensions | | | | | Fasteners | | | | Allowable Loads | | | |
|-----------|----------------|----------------|----|-------|----------------|-----------|-----|------|-----|-----------------|----------|----------|-----------|
| | W ₁ | W ₂ | L | | H ₁ | Beam | | Post | | Uplift | | Down | |
| | | | CC | ECC | | Qty | Dia | Qty | Dia | CC (133) | CC (160) | CC (100) | ECC (100) |
| CC66 | 5 1/2 | 5 1/2 | 11 | 7 1/2 | 6 1/2 | 4 | 5/8 | 2 | 5/8 | 3365 | 3660 | 37810 | 18905 |

Toll Free 800-348-2326

Fax 574-267-8572

www.lrcproducts.com